



Pre Calibration

Company Information

Name: Portrait Displays

Phone:

Address Line 1:

Address Line 2:

City:

State: Zip:

Calibrator: Gorm Sørensen

Report Generated: 06.09.2020

Display Information

Manufacturer: Default

Model: Display

Serial:

Calibration Equipment




Meter:

Source: Murideo 6G Generator

Grayscale

Grayscale Avg dE: 2000 2,1



Grayscale Max dE: 2000 3,4

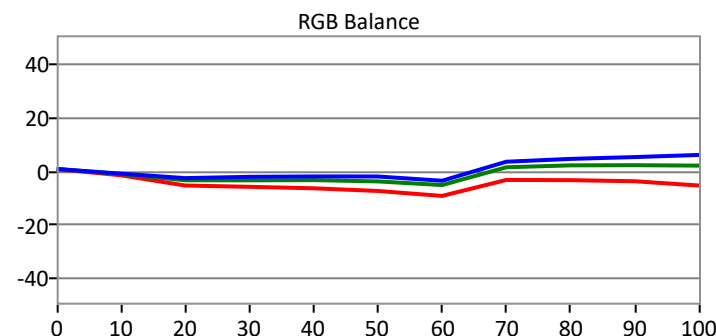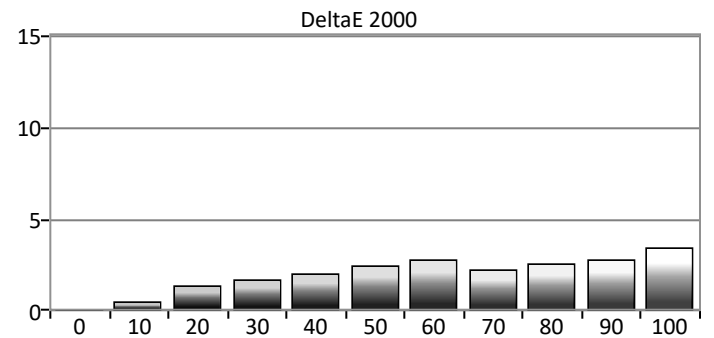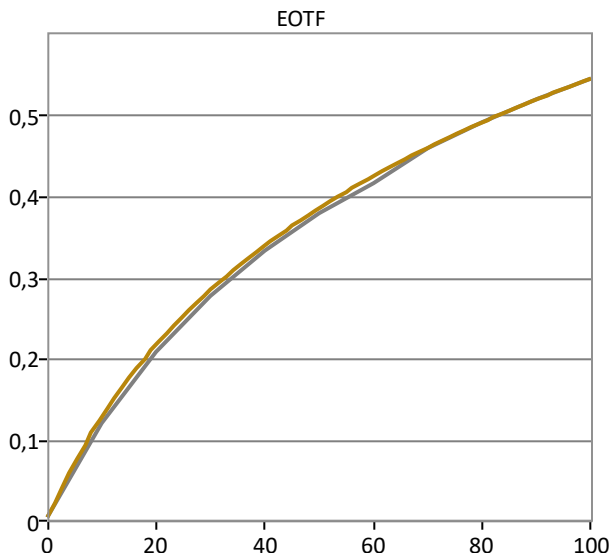

Colorspace

Colorspace Avg dE: 2000 1,7

Colorspace Max dE: 2000 3,4

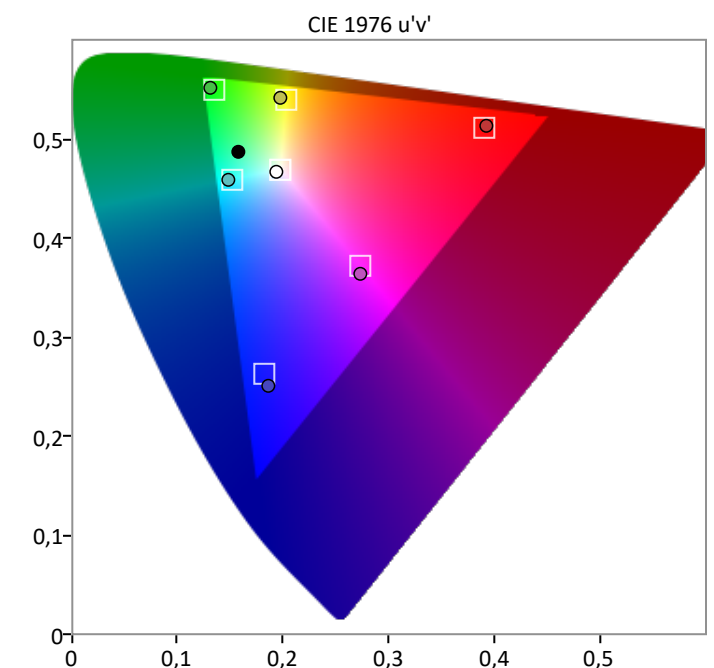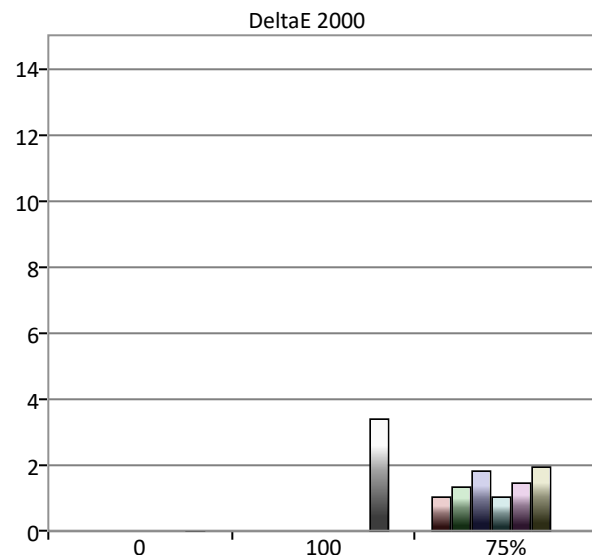



Post Calibration

Company Information

Name: Portrait Displays

Phone:

Address Line 1:

Address Line 2:

City:

State: Zip:

Calibrator: Gorm Sørensen

Report Generated: 06.09.2020

Display Information

Manufacturer: Default

Model: Display

Serial:

Calibration Equipment




Meter:

Meter Mode:

Grayscale

Grayscale Avg dE: 2000 1,1



Grayscale Max dE: 2000 2,1

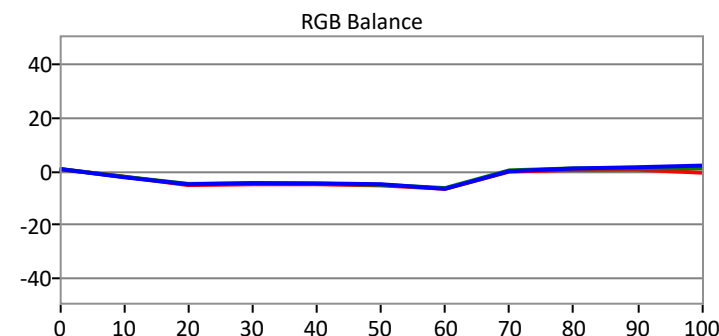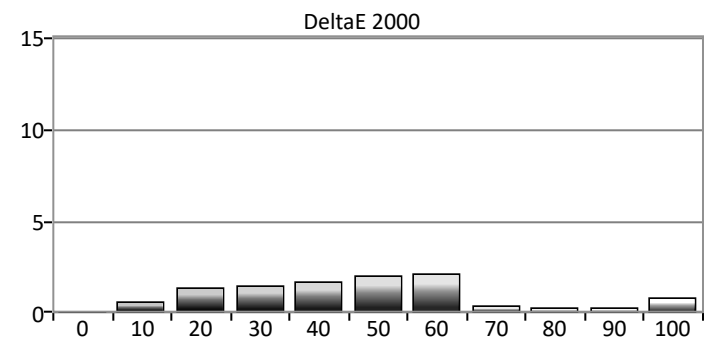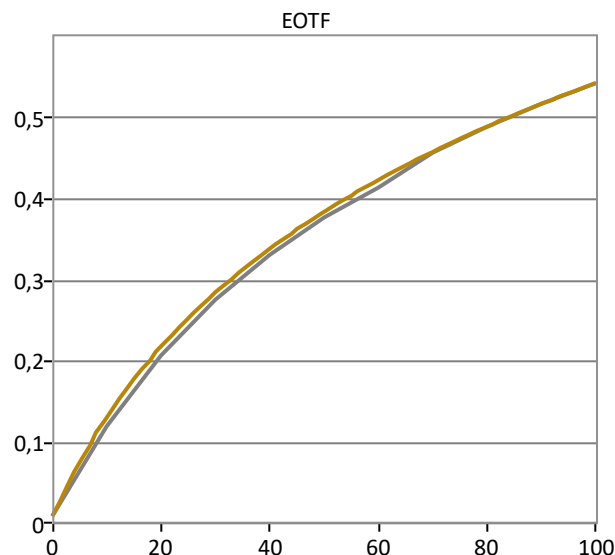

Colorspace

Colorspace Avg dE: 2000 1,2

Colorspace Max dE: 2000 1,7

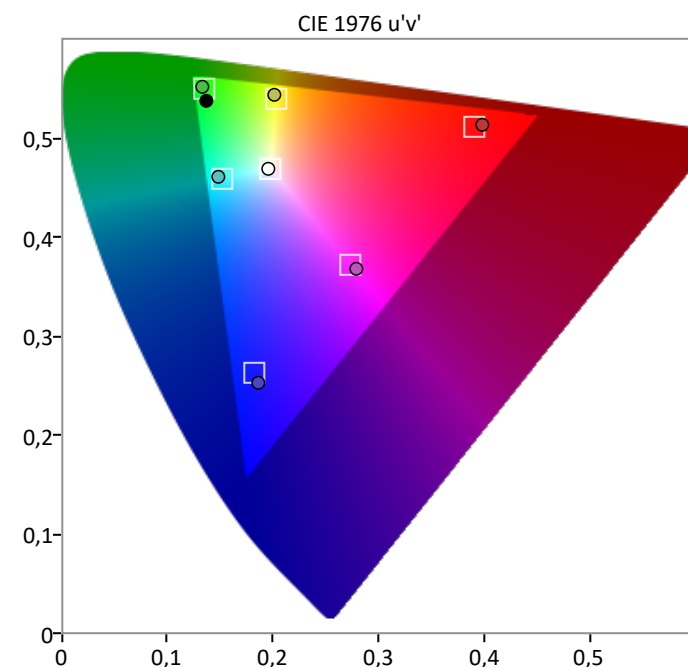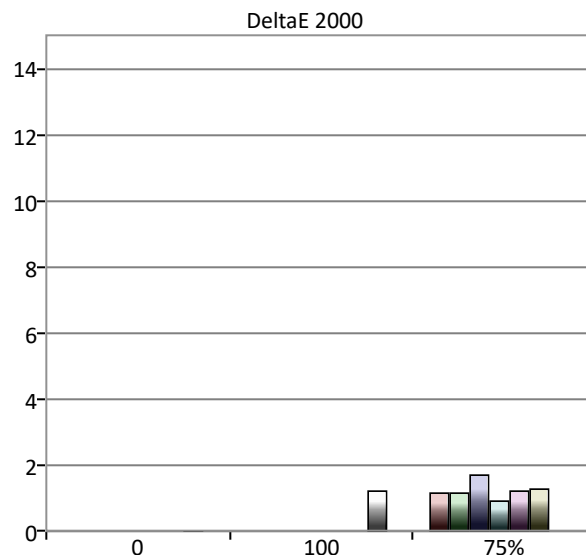



Calibration Notes

Company Information

Name: Portrait Displays

Phone:

Address Line 1:

Address Line 2:

City:

State: Zip:

Report Generated: 06.09.2020

Display Information

Manufacturer: Default

Model: Display

Serial:

Calibration Equipment

Meter:

Meter Mode:

Pre Cal Notes

Pre-Cal Notes:

Filmmaker mode

Post Cal Notes

Post-Cal Notes:

Filmmaker mode med korrigert hvitbalanse (2-punkt)





ColorChecker

Company Information

Name: Portrait Displays

Phone:

Address Line 1:

Address Line 2:

City:

State: Zip:

Report Generated: 06.09.2020

Display Information

Manufacturer: Default

Model: Display


Serial:

Calibration Equipment

Meter:

Meter Mode:

ColorChecker

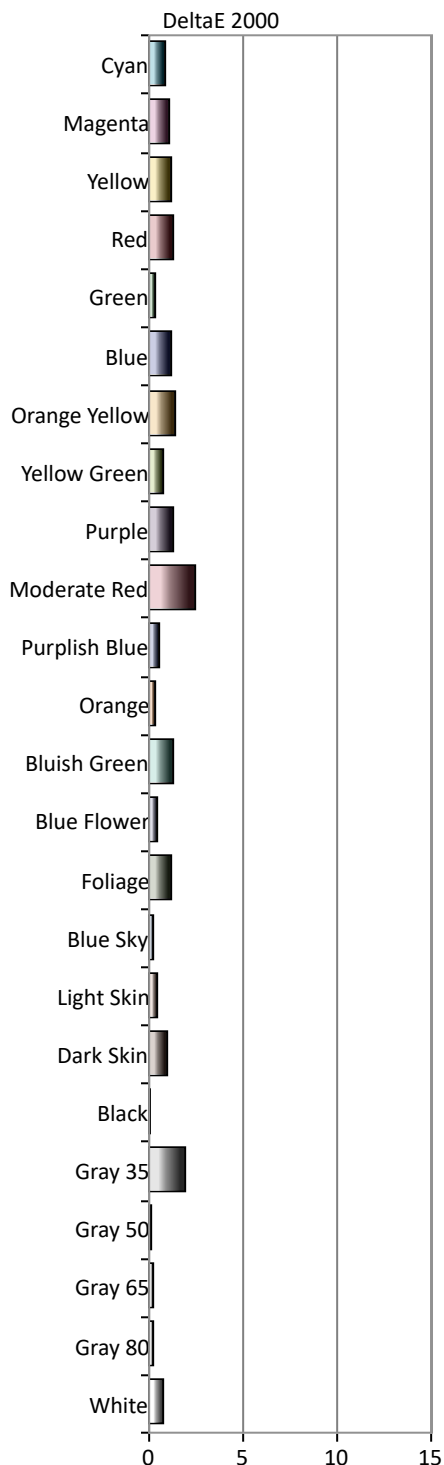


Saturations Avg dE: 2000

0,9

Saturations Max dE: 2000

2,5

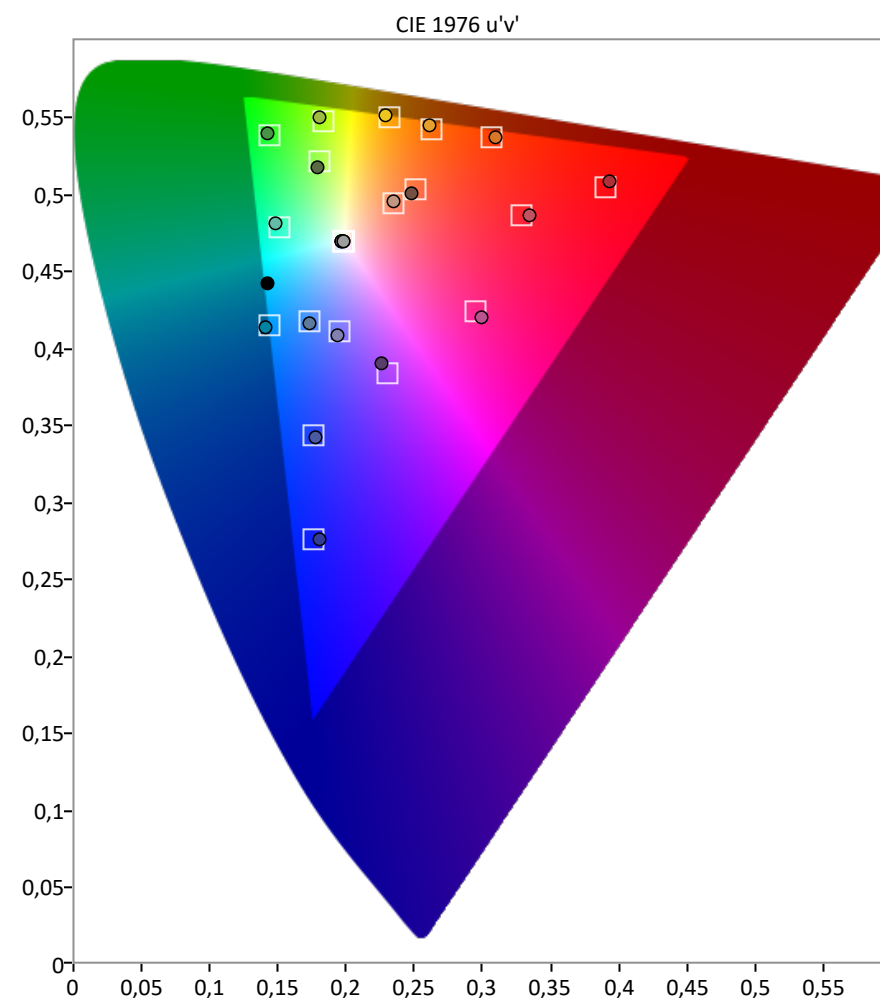

Saturation Sweeps



Saturations

Company Information

Name: Portrait Displays

Phone:

Address Line 1:

Address Line 2:

City:

State: Zip:

Report Generated: 06.09.2020

Display Information

Manufacturer: Default


Model: Display

Serial:

Calibration Equipment

Meter:

Meter Mode:

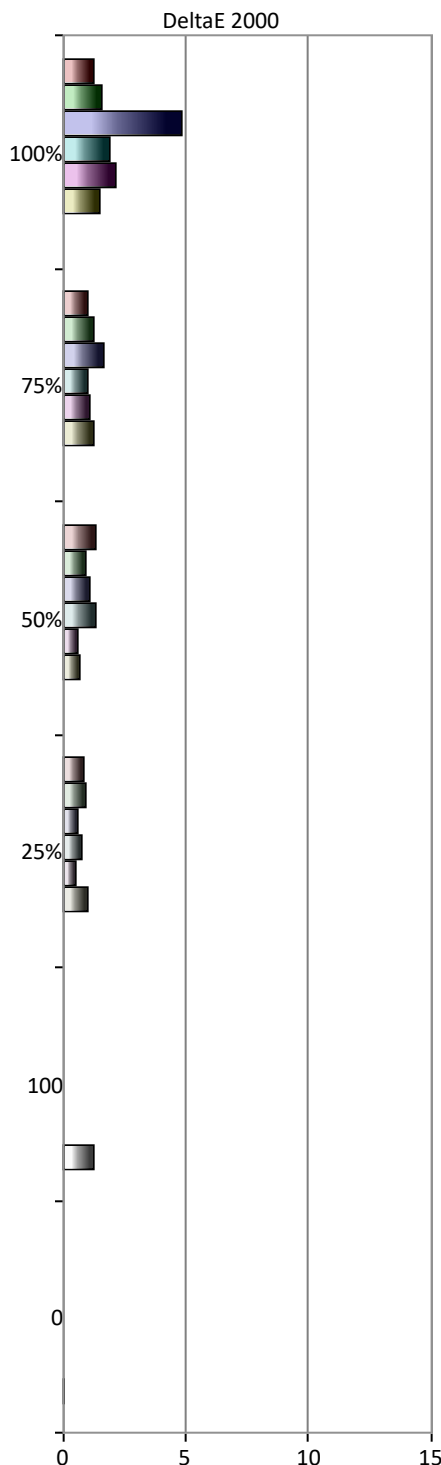

Saturations Avg dE: 2000

1,3

Saturations Max dE: 2000

4,8

